

A Proportional Investigation among UPFC and DPFC in Grid Associated Photovoltaic Organization

P. RAJENDRA BHANUTEJA¹, K. PAVANI², J. ANUSHA³, T. KRISHNA RAO⁴, A. BALA RAMA KRISHNA⁵
 Department of Electrical and Electronics Engineering

Chalapathi Institute of Engineering & Technology, Lam, Guntur, Andhra Pradesh, INDIA-522032

Abstract— In this paper a proportional investigation between Unified Power Flow Controller (UPFC) and Distributed Power Flow Controller (DPFC) in a grid incorporated photovoltaic system is performed. A grid connected solar generation scheme with boost converter and voltage source inverter (VSI) is taken as the key model. Due to power quality issues like power oscillations, harmonic distortions, voltage sags and swells, the grid side system has to be absolutely monitored and restricted. One way to mitigate these power quality troubles is by using reactive elements like shunt/series reactor and shunt/series capacitor. The drawback on using these reactive elements is sub synchronous resonance phenomenon. Gratitude to FACTS equipment, which emerged out as power conditioning units and helps to feed power with required standards and free from power quality issues. Among them, the contemporary FACTS devices are Controller Distributed Power Flow (DPFC) and Unified Power Flow Controller (UPFC). Though the aim of both the devices is same but their working principles are different. In this paper the effect of adding a DPFC and UPFC to a solar PV generation system is analyzed. A detailed working principle and operation of both the devices were presented. At last, MATLAB/SIMULINK environment is used to evaluate the performances of above mentioned devices.

Key Words: DPFC, UPFC, Solar, power quality, Distributed Power

I. INTRODUCTION

The demand for power is growing at a fast pace. This in turn demands the increase of power generation as well as power transmission. The renewable energies are taking up the market as far as power generation is concerned. For increasing power transmission, one way is, to increase the number of lines throughout the grid; this is hectic, and the other way is to upgrade the existing lines. Again the high demand of power flow in power systems is increasing day by day. Flexible AC transmission system abbreviated as FACTS are the devices which have the capability to control transmission line parameters, in other words, these devices control the flow of power through high voltage lines and can utilize those lines to their respective maximum possible thermal limits as stated in [1]. Flexible AC Transmission Systems (FACTS) gives great improved solutions to today's power systems problems. It enhances the capability to transfer flow of power, continuous control over the system voltage, also decreases system oscillations within the network etc. The technology of FACTS includes high rated power electronics equipped instruments. Power flow is control is achieved by adjusting the variable parameters of a system, such as voltage magnitude, transmission angle and impedance of the line. Based on device connectivity in a system, FACTS can be classified into series devices most interesting fact about DPFC is, it uses the third harmonic component of current. According to power theory of non-sinusoidal components, transfer of power using harmonic frequency does not affect the power transfer using fundamental frequency as explained in [4]. The eliminated dc link offers flexibility in independent installation of series converters. Moreover the series converters are of low rating and they don't need any high voltage isolation with the ground. Hence the cost is reduced comparatively [5].

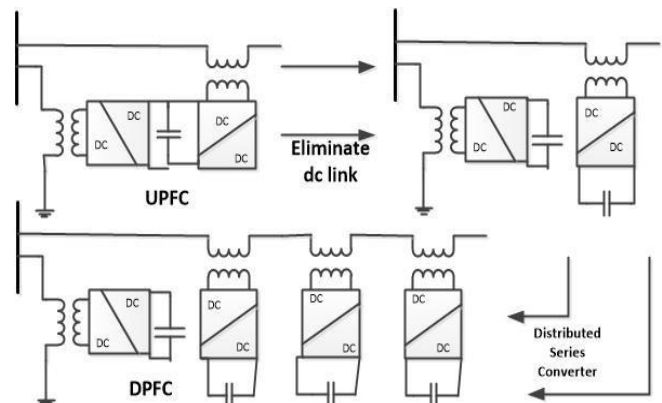


Fig. 1 A schematic diagram which represents UPFC to DPFC conversion

In brief, to change UPFC to DPFC: 1) eliminate dc link connection linking shunt and series converter, 2) change all three phase converters to single phase converters and 3) Series converters are distributed as shown in Figure.1. The paper begins with main model description which is explained in section-II, followed by working principles of DPFC section-III and UPFC in section-IV. The simulation results by utilizing MATLAB/SIMULINK environment shown in section-V. Section-VI consists of conclusion and is followed by reference .

II. SYSTEM DESCRIPTION

A. Solar PV system

The system under study is a grid connected PV model. It comprises of a solar generator and its modeling explained in [6], followed by a boost dc-dc chopper [7] and grid connected voltage sourced inverter (VSI) [9] through a transformer as shown in Fig.2. Perturb & Observe

algorithm (P & O)[8] is followed for tracking the maximum power from the solar panel. The solar panel used is Mitsubishi PV with 5 numbers of series connected modules and only 1 parallel connected module. The model variables are displayed in Table 1.

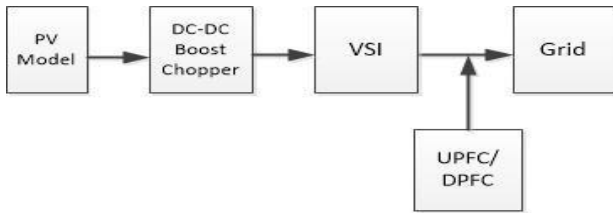


Fig. 2 The PV system in MATLAB/ Simulink.

TABLE I SOLAR PV SPECIFICATIONS

PARAMETERS	VALUES
PV cell OC Voltage(V_{oc})	30.8 V ($V_{mpp}= 24.69$ V)
PV cell SC current(I_{sc})	8.23 A ($I_{mpp}= 7.71$ A)
PV cell Maximum power(P_{max})	190 Watts
Dc link reference(V_{dc})	500 V
Transformer	440V / 25kV, 1000VA, 50Hz
Grid voltage	25 kV

III. UNIFIED POWER FLOW CONTROLLER

Unified Power Flow Controller (UPFC) falls under the Class of combined FACTS devices. Two three-phase converters are joined back to back in series using a dc link which is common. The series converter executes the prime task of UPFC [2][3]. The series converter introduces desired voltage of desired magnitude and desired angle into line which in turn controls the flow of power through that line. The shunt converter aids the series converter by supplying the needed active power along the dc link capacitor. At the same time the shunt converter also injects controllable current at the point of interconnection to control voltage profile near to 1 p.u.(All the quantities expressed in the paper are in p.u.). The series converter used is Static Series Synchronous Compensator (SSSC) and the shunt converter used is a Static Synchronous Compensator (STATCOM).

2.2 Shunt Controller

The shunt controller in a UPFC works exactly like a STATCOM [10]. The main function is to charge the dc link capacitor voltage, which could be utilized by the series converter for power flow control. Additionally, it also Maintains the voltage profile at the connection point. The control structure is shown in Fig.3. It accepts V_{dcref} and V_{ref} (desired set point) as the reference values. The error which occurs between the V_{dcref} and shunt dc voltage (V_{shdc}) is well tuned by a conventional PI regulator which results I_{dref} . Similarly the I_{qref} is generated by well-tuned PI regulator which regulates error between desired point and grid side voltage component. The same vector current control method is implemented [11][12].

The series control strategy uses the same vector current control mechanism explained in [11]. The control structure is shown in Figure.4. The primary purpose of the series converter is to use capacitor voltage of the dc link and generate the exact real and reactive power at the line. It mainly takes two reference values, namely the P_{ref} and Q_{ref} . The I_{dref} and I_{qref} can be obtained by comparing P_{ref} with $V_{d,grid}$ and Q_{ref} with $V_{d,grid}$ and with the hel

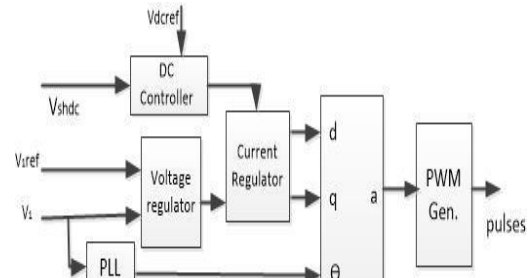


Fig. 3 UPFC shunt control block diagram

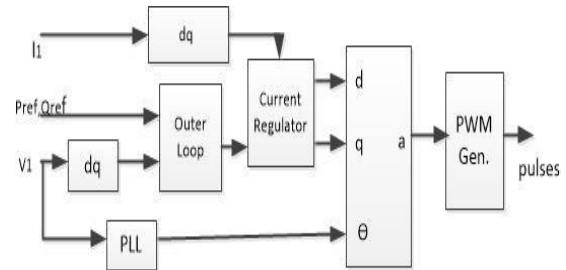


Fig. 4 UPFC series control block diagram

IV. DISTRIBUTED POWER FLOW CONTROLLER

Distributed Power Flow Controller also falls under Combined FACTS devices. Its anatomy is same like that of UPFC, but it uses both series and shunt converters without the dc capacitor link [4]. The series converter uses the Distributed series static compensation (DSSC concept)[4]. It uses many single phase converters of low rating (one for each phase) connected to the line itself through single turn transformers. This makes the installation of DPFC very easy. The number of series Converters utilized depend on the desired power output. In DPFC only one shunt converter is used. Its main objective is to provide real power to the series converters. In addition to these a pair of star delta transformer is also required. The two transformers are used for injecting 3rd harmonic component into the line and later remove it from the line. As delta appears to be an open circuit for 3rd harmonics, by using the proper placement of these transformers, perfect channeling of 3rd harmonic component can be done. Moreover it is easy to filter out 3rd harmonic components from the network i.e. by grounding the neutral of a star delta transformer as displayed in Figure 5.

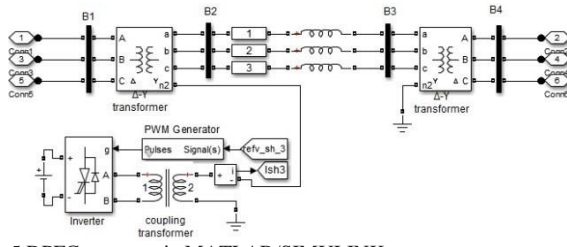


Fig. 5 DPFC structure in MATLAB/SIMULINK.

A. Shunt Controller

The function of shunt controller is to introduce a 3rd harmonic current to the transmission line and to retain the capacitor dc link voltage as displayed in Figure.6 and Figure.8. Where Fig. 6 represents the schematic form and Figure.8 represents in MATLAB/SIMULINK form. Injecting a 3rd harmonic current into the system without affecting the overall system is difficult. That's the reason the star-delta transformers are used. The transformer neutral terminal is used as the path to inject the current. As it is injected at the neutral, the 3rd harmonic component will divide itself equally throughout the three phases. The third harmonic current (I_{sh3}) is resolved into two components mainly (I_d and I_q). The phase angle (ξ_{sh}) of the grid voltage is extracted through a phased locked loop (PLL). The phase angle (ξ_{sh}) and (I_d and I_q) are combined together to generate modulated signal. The modulation waveform is compared with triangular carrier signal with frequency (6000Hz) to generate the pulses.

B. Series Controller

The function of series converter is to charges its own capacitor voltage utilizing the 3rd harmonic component in the line, which is injected by the shunt converter and at the same time it introduces a voltage at the point of interconnection, this in turn manages the real and reactive power flow through the line. The controller accepts three references namely, $V_{sedcref}$, P_{ref} and Q_{ref} . The interesting fact about this controller is that it charges its capacitor through 3rd harmonic frequency component but injects the voltage at fundamental frequency [4]. As a result it needs two control structures, one for 3rd harmonic and the other for fundamental frequency. The control model is depicted in Figure.7 and Figure.9, where Fig.7 represents the schematic form and Fig.9 represents in MATLAB/SIMULINK form. In Fig.7.two control strategies can be noticed. In one control strategy, series dc voltage (V_{sedc}) and V_{dcref} are compared and the error calculated is processed through a PI tuner that generates V_d, V_q is chosen as zero. The grid current (i) contain both

Extract 3rd harmonic component, band pass filter of cut-off frequency 150 Hz is used. PLL is used to extract phase angle (ξ_{se1}) from 3rd harmonic component. V_d, V_q and ξ_{se1} are used to generate a single phase modulating signal. The second control strategy consists of P_{ref} and Q_{ref} which generates I_{dref} and I_{qref} as explained in equations (1)(2) and inner loop generates V_d, V_q and the (ξ_{se2}) is obtained through PLL in order to generate a single modulating signal. The modulating signal from the first control strategy and from the second control strategy

are aided together and compared with triangular carrier generator of 6000Hz to generate pulses to the converter.

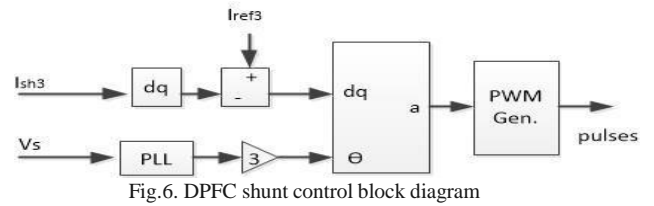


Fig.6. DPFC shunt control block diagram

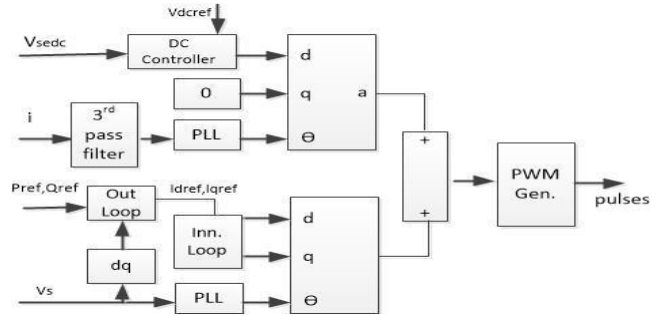


Fig.7. DPFC series control block diagram

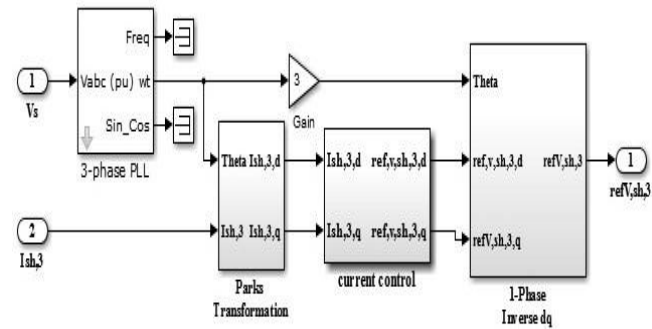


Fig. 8 DPFC shunt control in MATLAB/SIMULINK

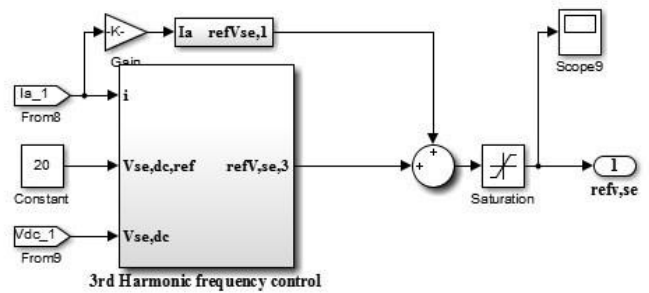


Fig. 9 DPFC series control in MATLAB/SIMULINK

VII.RESULTS

The FACTS devices are added exactly after the voltage source inverter. A 1000VA rated UPFC is connected before the grid. The references for Real power and Reactive power are taken as -0.5 p.u initially. At 0.9s the V_{dcref} is 500 volts. For shunt controller $K_p=0.12$ and $K_i=300$. For series controller, $K_p=0.02$ and $K_i=10$. The results for UPFC are shown from Fig. 10 to Fig 13.

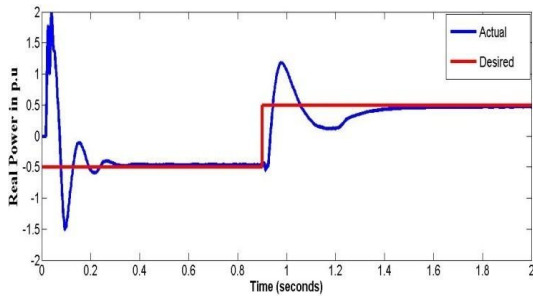


Fig. 10 Real Power plot using UPFC

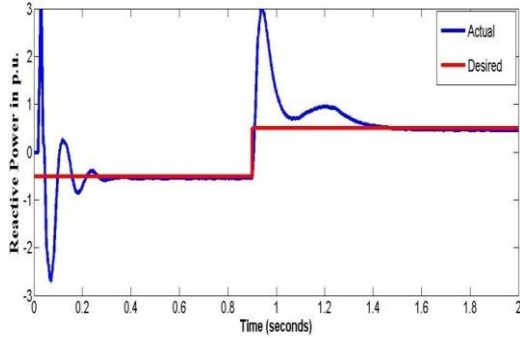


Fig. 11 Reactive Power plot using UPFC

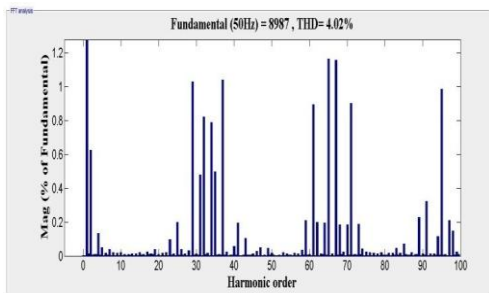


Fig. 12 Voltage THD using UPFC

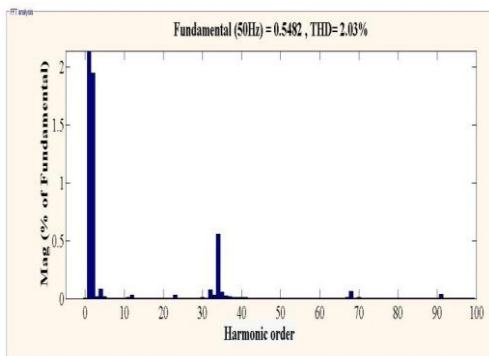


Fig. 13 Current THD using UPFC

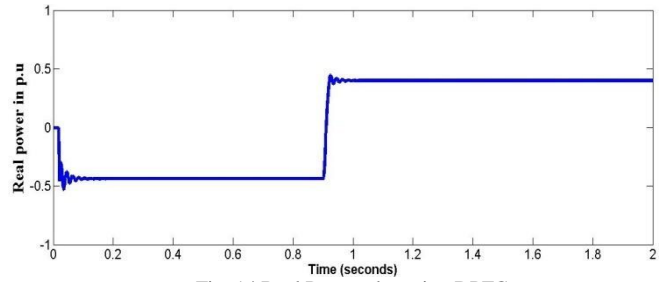


Fig. 14 Real Power plot using DPFC

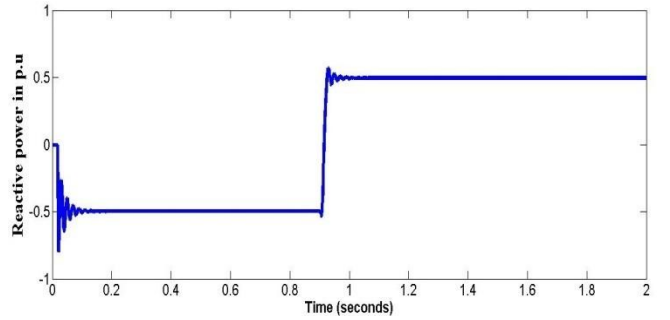


Fig. 15 Reactive Power plot using DPFC

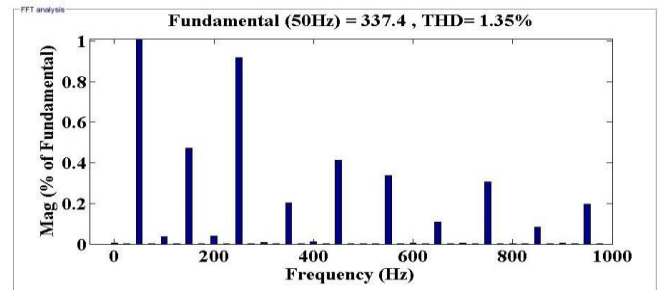


Fig. 16 Current THD using DPFC

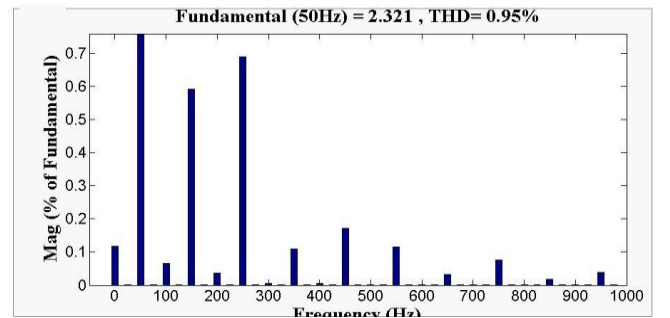


Fig. 17 Voltage THD using DPFC

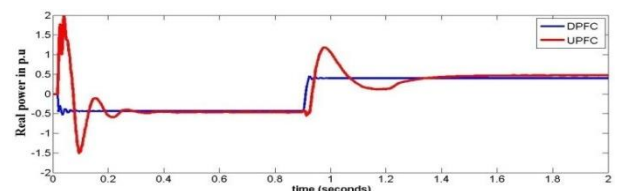


Fig. 18 Real Power plot using UPFC & DPFC.

The DPFC is connected just between the grid tied inverter and the main grid. The DPFC rated at 1000VA uses one single phase shunt converter and three series converter one for each phase. The I_{shref3} is 3A and the $V_{dcrefsh}$ is 50V. For shunt controller $K_p=0.09$, $K_i= 0.48$. For series controller $K_p=0.5$, $K_i=20$ The results obtained with DPFC are shown from Fig. 14 to Fig. 17.

TABLE II. OBSERVATION

Parameters	TARIEEC	DPFC
Real Power (ref: -0.5 to 0.5)	-0.46	-0.49
	0.44	0.44
Reactive Power (ref: -0.5 to 0.5)	-0.55	-0.48
	0.46	0.49
Voltage THD (%)	4.02	0.95
Current THD (%)	2.03	1.35

CONCLUSIONS

The working principle and control structure of UPFC and DPFC is illustrated in detail with corresponding block diagrams. Using the results obtained through MATLAB/SIMULINK it is concluded that DPFC have superior characteristics as compared to UPFC in power tracking and Total harmonic distortion (THD). The detailed comparison is shown in TABLE II which depicts the improvement of voltage THD and current THD at the output terminals. Voltage THD decreases from 2.03% to 0.95 %. On the other hand, current THD is decreased from 4.02% to 1.35%. In brief the disadvantages of UPFC can be overcome using DPFC.

REFERENCES

[1] Mai Mahmood Aladani, Azza Ahmed Eldosousky, Abdelha Abdel Sallam, "Power System Transient Stability: An Algorithm for Enhancement and Assessment based on Catastrophe theory and FACTS devices" IEEE Access, Vol. 6, pp. 26424-26437, May 2018.

[2] N. G. Hingorani and L. Gyugui, Understanding FACTS, IEEE Press, New York, 1999.

[3] Yang Liu, Shuitao Yang, Xiarui Wang, Deepak Gunasekaran, Ujjwal Karki, Fang Zeng Peng," Application of transformer less UPFC for interconnecting Two synchronous AC grids with Large Phase Difference", IEEE Trans on Power Electronics. Vol. 31, Issue. 9, pp 6092-6103, September, 2016.

[4] Zhihui Yuan, Jan Braham Ferreira, "A FACTS Device: Distributed Power Flow Controller (DPFC)," IEEE Transactions on Power Electronics, Vol. 25, No. 10, October, 2010.

[5] Ahmad Jamshidi, S. Masoud Barakti, Mohammad Moradi Ghahderijaani, "Power Quality Improvement and Mitigation Case Study Using Distributed Power Flow Controller," IEEE International Symposium on Industrial Electronics, Vol. 12, No. 8, May 2012.

[6] Habbati Bellia, Ramdani Youcef, Moulay Fatima, "A detailed modeling of photovoltaic module using MATLAB," National Research Institute of Astronomy and Geophysics, pp. 53-61, May 2014.

[7] Hauke, Brigitte. Basic calculation of a boost converter's power stage. Texas Instruments, Dallas, Texas, Tech. Rep. SLVA477, 2014

[8] Sheik Mohammed, D. Devaraj and T.P. Imthias Ahamed, "A Novel hybrid Maximum Power Point Tracking technique using Perturb & Observe Algorithm and Learning Automata for solar PV system", ENERGY (Elsevier).July 2016, 112 (2016) 1096- 1106.

[9] Aliaga, J. Munoz, F. Cadena and J. Guzman, "Voltage source converter based STATCOM with predictive and fuzzy control," 2016 IEEE International Conference on Automatica (ICA-ACCA), Curico, 2016, pp. 1-7.

[10] Rajiv K Verma, Reza Salehi, " SSR mitigation with a new control of PV solar farm as STATCOM (PV-STATCOM)" IEEE Transaction on Sustainable Energy,

Vol 8, Issue 4,pp. 1473-1483, October 2017.

[11] PM. Awasth and V. A. Huchche, "Reactive power compensation using D-STATCOM," 2016 International Conference on Energy Efficient Technologies for Sustainability (ICEETS), Nagercoil, 2016, pp. 583-585.

[12] A.J.F Keri, K.K Sen." Compsrison of field results and digital simulation results of voltage source converter based FACTS controllers,"IEEE Transactions on power delivery, vol.18, Issue 1, Jan 2003.

[13] Sheik Mohammed, D. Devaraj and T P Imthias Ahamed, "Modeling, Simulation and Analysis of Photovoltaic Modules under Partially Shaded Conditions" Indian Journal of Science and Technology, April 2016.

[14] U.P Mhaskar, A.M Kulkarni, "Power oscillation damping using FACTS devices: modal controllability, observability in local signals, and location of transfer function zeros,"IEEE Transactions on power system, vol.21,No.1,pp.285-294, Jan 2006.